



This Datasheet for the

IC670MDL233

120VAC 8 Pt. Isolated Input

<http://www.cimtecautomation.com/parts/p-14510-ic670mdl233.aspx>

Provides the wiring diagrams and installation guidelines for this GE Field Control module.

For further information, please contact Cimtec Technical Support at

1-866-599-6507

sales@cimtecautomation.com


Discrete Input Module

IC670MDL233

GFK-1368B
June 1997

120 VAC Isolated Input Module

The 120VAC Isolated Input Module (IC670MDL233) provides 8 isolated discrete inputs.

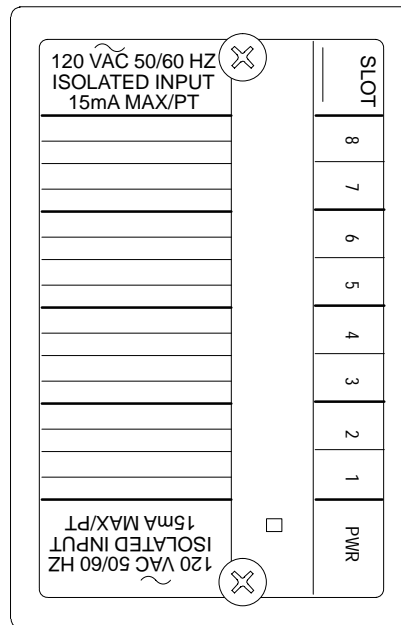

46766

Power Sources

The module receives power from the Bus Interface Unit for its own operation.

An external 120VAC supply is needed to power the input devices. Module inputs respond to voltage levels from 0 VAC to 132 VAC.

LEDs

Individual LEDs, visible through the transparent portion of the module top, indicate the on/off status of each input. The PWR LED is on when backplane power is present.

Host Interface

Intelligent processing for this module is performed by the Bus Interface Unit or elsewhere in the system. This includes configuring features such as input defaults and fault reporting. The module has 8 bits (one byte) of discrete input data. A Bus Interface Unit is required to provide this input data to the host and/or local processor.

GFK-1368B
June 1997


120 VAC Isolated Input Module

Module Operation

A network of resistors and capacitors establishes input thresholds and provides input filtering. Optoisolators provide isolation between the field inputs and the module's logic components. Data from all 8 inputs is placed into a data buffer. The module's circuit LEDs show the current states of the 8 inputs in this data buffer.

A parallel-to-serial converter change input data from the data buffer into the serial format needed by the Bus Interface Unit.

After checking the Board ID and verifying that the module is receiving appropriate logic power from the Bus Interface Unit (which is reflected by the state of the module's Power LED), the Bus Interface Unit then reads the filtered, converted input data.

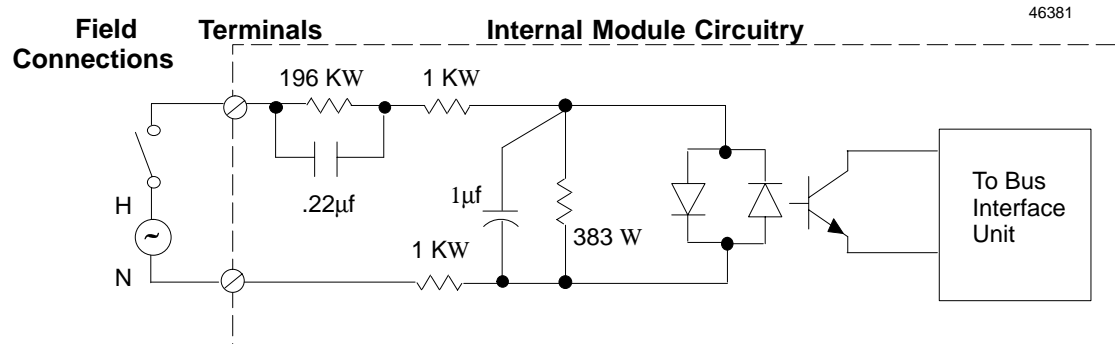

Module Specifications

Module Characteristics	
Rated Voltage	120 VAC
Input Voltage Range	0-132 VAC (47-63 Hz)
User Input Current	13 mA (typical) per point @ rated voltage
Indicators	1 LED per point shows individual point status PWR LED indicates backplane power is present
Isolation: User input to logic, user input to frame ground.	250 VAC continuous, 1500 VAC for 1 minute.
Point to point	300 VAC continuous
Current Drawn from Bus Interface Unit Power Supply	40 mA maximum
Input Characteristics	
Input Impedance	10K typical (reactive)
On state voltage	70 VAC to 120 VAC
Off state voltage	0 VAC to 20 VAC
On state Current	5mA to 15mA
Off state Current	0mA to 2.5mA
On response time	10ms typical, 20 ms maximum
Off response time	20ms typical, 40 ms maximum

120 VAC Isolated Input Module

GFK-1368B
June 1997

Keying Locations

Optional keying locations for the 120VAC Isolated Input Module are shown below.

Keying Locations									
A	B	C	D	E	F	G	H	J	K
	✓			✓	✓			✓	

Field Wiring

I/O Terminal Block wiring assignments for this module are shown below.

The Terminal Block with box terminals has 25 terminals for each module, each of which accommodates one AWG #14 (avg 2.1mm² cross section) to AWG #22 (avg 0.36mm² cross section) wire, or two wires up to AWG #18 (avg. 0.86mm² cross section). When an external jumper is used, the wire capacity is reduced from AWG #14 (2.10mm²) to AWG #16 (1.32mm²).

The I/O Terminal Block with barrier terminals has 18 terminals per module. Each terminal can accommodate one or two wires up to AWG #14 (avg 2.1mm² cross section).

The I/O Terminal Block with Connectors has one 20-pin male connector per module. The mating connector is Amp part number 178289-8. Any tin-plated contact in the AMP D-3000 series can be used with the connector (Amp part number 1-175217-5 for high contact force receptacle for 20-24 gauge (0.20-0.56mm²) wires, 1-175218-5 for high contact force receptacle for 16-20 gauge (0.56-1.42mm²) wires).

I/O Terminal Block with Box Terminals (IC670CHS002 and 102)				I/O Terminal Block with Barrier Terminals (IC670CHS001 and 101)				I/O Terminal Block with Wire to Board Connectors (IC670CHS003 and 103)			
Neutral 8	16	15	Input 8	Neutral 8	16	15	Input 8	Input 6	11	10	Neutral 5
Neutral 7	14	13	Input 7	Neutral 7	14	13	Input 7	Neutral 6	12	9	Input 5
Common	E8			Neutral 6	12	11	Input 6	Input 7	13	8	Neutral 4
Neutral 6	12	11	Input 6	Neutral 5	10	9	Input 5	Neutral 7	14	7	Input 4
Neutral 5	10	9	Input 5	Neutral 4	8	7	Input 4	Input 8	15	6	Neutral 3
Common	E6			Neutral 3	6	5	Input 3	Neutral 8	16	5	Input 3
Neutral 4	8	7	Input 4	Neutral 2	4	3	Input 2	NC	A2	4	Neutral 2
Neutral 3	6	5	Input 3	Neutral 1	2	1	Input 1	NC	A1	3	Input 2
Common	E4			Neutral 1	2	1	Input 1	NC	B2	2	Neutral 1
Neutral 2	4	3	Input 2	NC	B	A	NC	NC	B1	1	Input 1
Neutral 1	2	1	Input 1								
Common	E2	E1	Common								
NC	B2	A2	NC								
NC	B1	A1	NC								
NC			NC								

Terminals E1, E2, E4, E6, and E8 are electrically connected together, A1 and A2 are electrically connected together, B1 and B2 are electrically connected together.

46767


120 VAC Isolated Input Module

Wiring Examples with Auxiliary Terminal Blocks

If the module is installed on an I/O Terminal Block with Box Terminals or Barrier Terminals, an Auxiliary Terminal Block may be required to provide additional wiring terminals. For the I/O Terminal Block with Wire to Board Connectors, external connection points are usually preferred, although an Auxiliary Terminal Block can be used.

Auxiliary Terminal Blocks have all terminals connected together internally. The Auxiliary Terminal Block with box terminals has 13 terminals; each accommodates one AWG #14 (avg 2.1mm² cross section) to AWG #22 (avg 0.36mm² cross section) wire, or two wires up to AWG #18 (avg. 0.86mm² cross section). The Auxiliary Terminal Block with barrier terminals has nine terminal; each can accommodate one or two wires up to AWG #14 (avg 2.1mm² cross section).

The following illustration shows how an optional Auxiliary Terminal Block with Box Terminals can be used for power connections when installing this module on an I/O Terminal Block with Box Terminals.

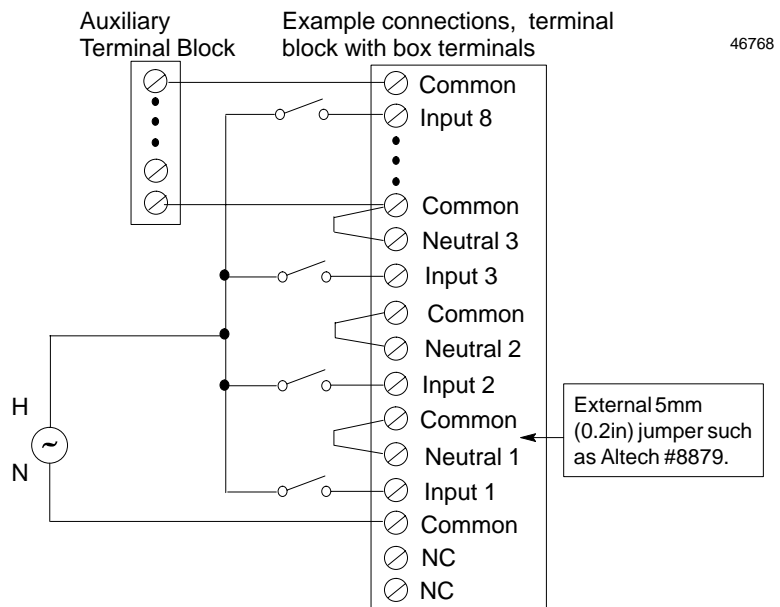

For an I/O Terminal Block with Barrier Terminals or an I/O Terminal Block with Wire to Board Connectors, an Auxiliary Terminal Block with Barrier Terminals might be connected as shown in the following example.

