



This Datasheet for the

[IC670MDL642](#)

125VDC Pos/Neg Logic Input 16 Pt. Grouped

<http://www.cimtecautomation.com/parts/p-14517-ic670mdl642.aspx>

Provides the wiring diagrams and installation guidelines for this GE Field Control module.

For further information, please contact Cimtec Technical Support at

1-866-599-6507

sales@cimtecautomation.com


Discrete Input Module

IC670MDL642

GFK-1136E
June 1997

125 VDC Positive/Negative Input Module

The 125 VDC Positive/Negative Input Module (IC670MDL642) provides a single group of 16 discrete inputs, which may be driven by positive or negative logic.

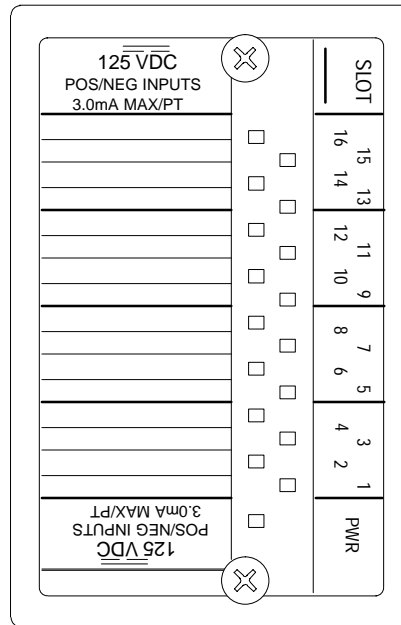

Power Sources

The module receives power from the Bus Interface Unit for its own operation. An external 125 VDC supply is needed to power the input devices that drive the module's inputs.

LEDs

Individual LEDs (logic side), visible through the transparent portion of the module top, indicate the on/off status of each input. The PWR LED is on when backplane power is present.

Host Interface

Intelligent processing for this module is performed by the Bus Interface Unit or elsewhere in the system. This includes configuring features such as input defaults and fault reporting. The module has 16 bits (two bytes) of discrete input data. A Bus Interface Unit is required to provide this input data to the host and/or local processor.


125 VDC Positive/Negative Input Module

Module Operation

A network of resistors, capacitors, and zener diodes establishes input thresholds and provides input filtering. Optoisolators provide isolation between the field inputs and the module's logic components. An oscillator and switch form a sampling circuit that is transparent to the controller and the LEDs that indicate the state of the inputs. Data from all 16 inputs is placed into a data buffer. The module's circuit LEDs show the current states of the 16 inputs in this data buffer.

Parallel-to-serial converters change input data from the data buffer into the serial format needed by the Bus Interface Unit.

After checking the Board ID and verifying that the module is receiving appropriate logic power from the Bus Interface Unit (which is reflected by the state of the module's Power LED), the Bus Interface Unit then reads the filtered, converted input data.


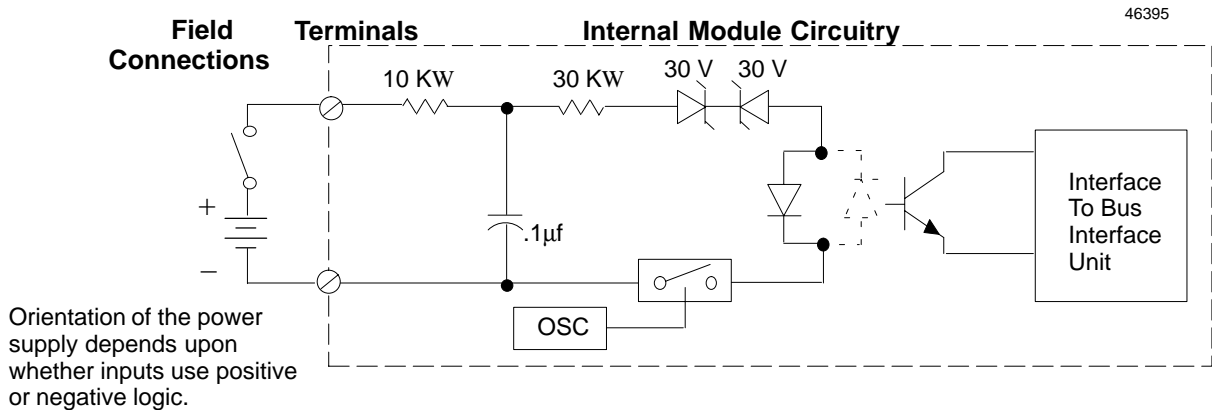


Positive or Negative Inputs

Inputs for this module can be either positive or negative inputs (all 16 inputs must be the same type). Both types of signals produce a logic 1 (true) when the switch is closed. Selection of positive or negative operation is made by the manner in which the external power supply is connected to the inputs and to the I/O Terminal Block.

Positive inputs receive current from input devices and supply current to the return or negative power bus. Input devices are connected between the positive power bus and the input terminals.

Negative inputs provide current to input devices and accept current from the source or positive power bus. Input devices are connected between the negative power bus and the input terminal.

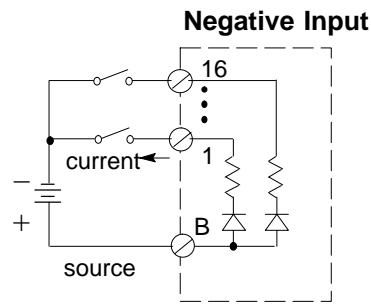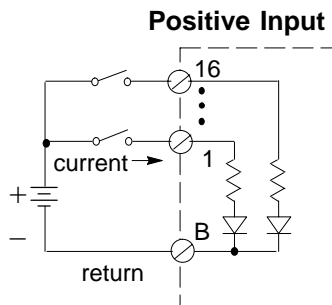


125 VDC Positive/Negative Input Module

GFK-1136E
June 1997

Field Wiring

The following illustration shows terminal assignments for the 125 VDC Positive/Negative Input Module.

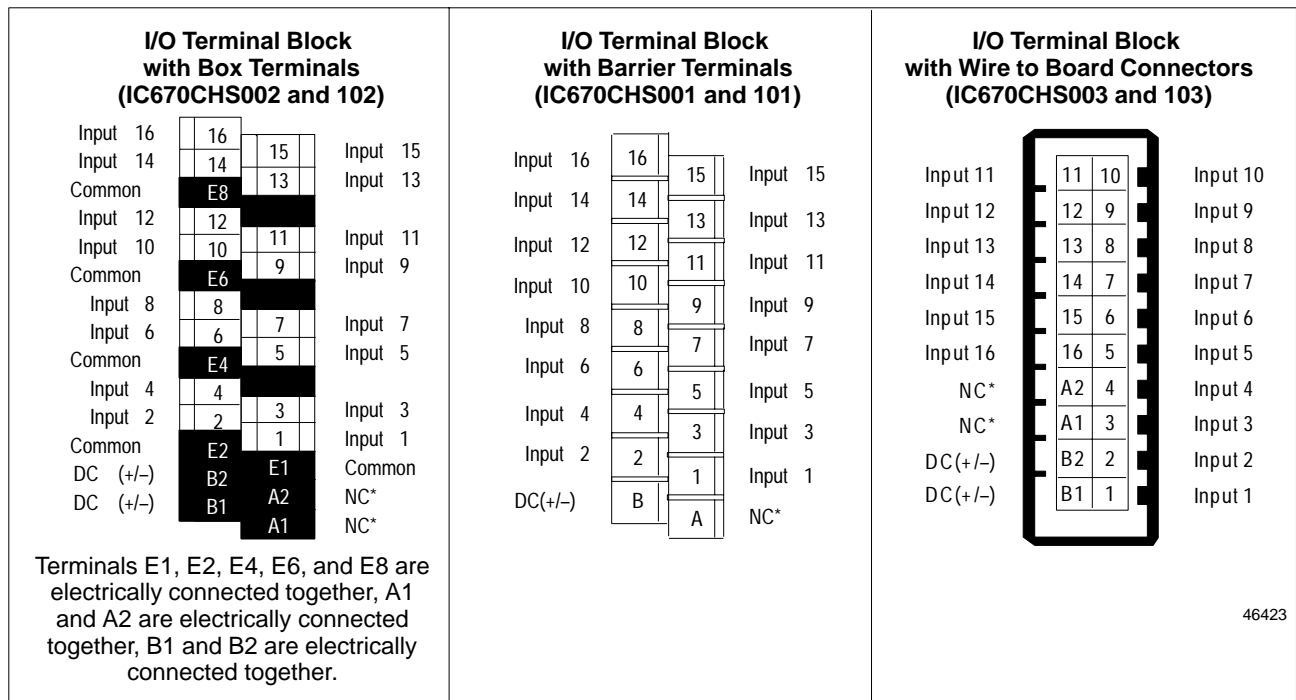

Connection to the A terminals is optional. They can be used as shown on the next page.

The Terminal Block with box terminals has 25 terminals for each module, each of which accommodates one AWG #14 (avg 2.1mm² cross section) to AWG #22 (avg 0.36mm² cross section) wire, or two wires up to AWG #18 (avg. 0.86mm² cross section). When an external jumper is used, the wire capacity is reduced from AWG #14 (2.10mm²) to AWG #16 (1.32mm²).

The I/O Terminal Block with barrier terminals has 18 terminals per module. Each terminal can accommodate one or two wires up to AWG #14 (avg 2.1mm² cross section).

The I/O Terminal Block with Connectors has one 20-pin male connector per module. The mating connector is Amp part number 178289-8. Any tin-plated contact in the AMP D-3000 series can be used with the connector (Amp part number 1-175217-5 for high contact force receptacle for 20-24 gauge (0.20-0.56mm²) wires), 1-175218-5 for high contact force receptacle for 16-20 gauge (0.56-1.42mm²).


125 VDC Positive/Negative Input Module

Wiring Examples with Auxiliary Terminal Blocks


If the module is installed on an I/O Terminal Block with Box Terminals or an I/O Terminal Block with Barrier Terminals, an Auxiliary Terminal Block may be required to provide additional wiring terminals. For the I/O Terminal Block with Wire to Board Connectors, external connection points are usually preferred, although an Auxiliary Terminal Block can be used..

Auxiliary Terminal Blocks have all terminals connected together internally. The Auxiliary Terminal Block with box terminals has 13 terminals, each of which accommodates one AWG # 14 (avg 2.1mm² cross section) to AWG #22 (avg 0.36mm² cross section) wire, or two wires up to AWG #18 (avg. 0.86mm² cross section). The Auxiliary Terminal Block with barrier terminals has nine terminals, each of which can accommodate one or two wires up to AWG #14 (avg 2.1mm² cross section).

The following illustration shows how an Auxiliary Terminal Block with Box Terminals can be used for power connections to an I/O Terminal Block with Box Terminals.

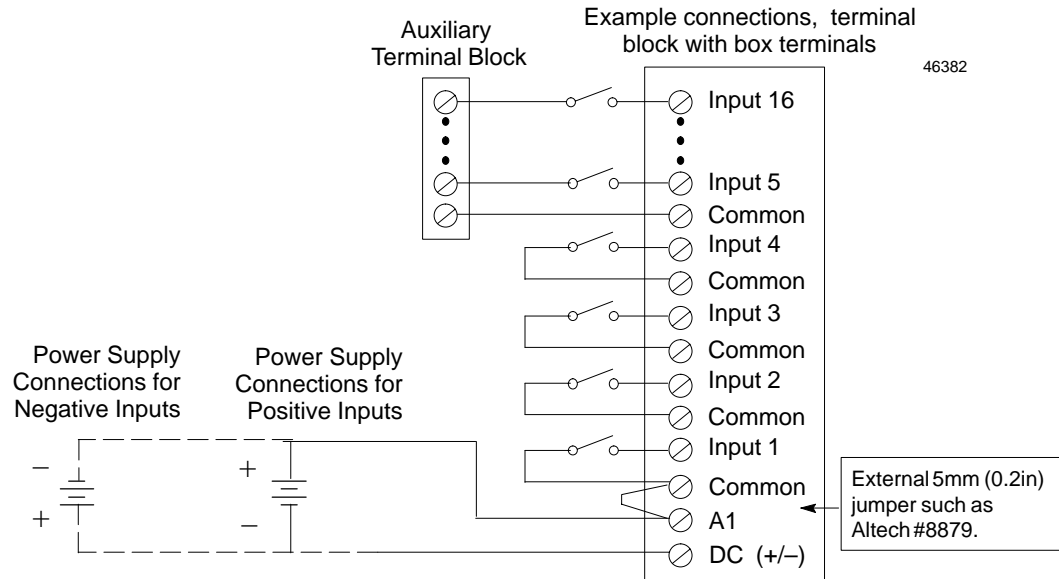

For an I/O Terminal Block with Barrier Terminals, an Auxiliary Terminal Block with Barrier Terminals might be connected as shown in the following example.

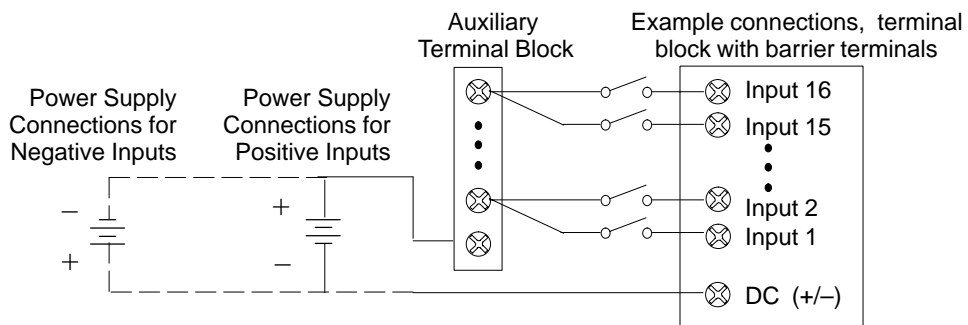

125 VDC Positive/Negative Input ModuleGFK-1136E
June 1997**Module Specifications**(Environmental and other general specifications are listed in the *User's Manual*.)

Module Characteristics	
Rated Voltage	125 VDC rated
Input Voltage Range	0 – 150 VDC
User Input Current	2.5 mA per point @ 125 VDC
Isolation: User input to logic, user input to frame ground, group to group	250 VAC continuous, 1500 VAC for 1 minute. No isolation between individual points in a group.
Indicators	1 LED per point shows individual point status PWR LED indicates field and backplane power are present
Current Drawn from Bus Interface Unit Power Supply	77 mA, maximum
Input Characteristics	
Input Impedance	40 K minimum
On State Voltage	Positive logic: +79V to +150V Negative logic: -79V to -150V
Off State Voltage	Positive logic: 0 to +30V Negative logic: 0 to -30V
On state Current	0.3mA to 3.0mA
Off state Current	0mA to 0.5mA
On response time	6ms typical, 20ms maximum
Off response time	13ms typical, 20ms maximum

Keying Locations

Optional keying locations for the 125 VDC Positive/Negative Input Module are shown below.

KeyingLocations									
A	B	C	D	E	F	G	H	J	K
✓				✓		✓	✓		

